

Veneta Engineering s.r.l.
 37135 VERONA Via Lovanio 8/10
 Telefono 0458200948 telefax 0458201982
 www.venetaengineering.it

Organismo notificato di certificazione europea n. 0505
 Macchine - Ascensori - Recipienti semplici a pressione - Rumore
 Organismo d'ispezione di tipo "A" Impianti elettrici
Laboratorio di Prove

9101
VERIFICA
ATTESA
DA LAVORO

Authorized by Ministero dello Sviluppo Economico on 15 Jan. 2008 pursuant to articles 10 & 11 part A of EEC Directive 89/686/EEC "PPE-Personal Protective Equipment" dated 01 Jan. 08 (C.U. no. 24 of 29 Jan. 08)

To:
HB SECURITY S.R.L.
VIA DELL ADIGE, 5
CORTACCIA

39040

BZ

TEST REPORT No. 297/EN VAR	date: 03/04/2012	ORIGINAL
Acceptance record no. 79788	date: 27/02/12	
TESTS ON ANCHOR DEVICES - PROTECTION AGAINST FALL FROM A HEIGHT		EN 795 P9101 33-32-0-1-0

dates: test start 23/03/2012 test end 23/03/2012 sample
samples delivered SAME-AS PRODUCTS

REF. (as declared by client)	MARKET NAME H-50 REVOLVING POSTS
	CHARACTERISTICS RIGID ARTEFACT FOR TWO USERS
	SAMPLING SITE

DECLARED CLASS (POINT 4.3) A1	STRUCTURAL ANCHORS DESIGNED FOR FIXING TO VERTICAL, HORIZONTAL, INCLINED SURFACES
GENERAL DATA	FIXING BASE FIXED WITH 6 M12 BOLTS depth 25 mm
	OVERHANG FROM BASE mm 500
	OVERHANG WITH FIXED SECTION
	LOAD APPLICABLE TO END RING
	PROTOTYPE - standardized production not checked



inspections, measures and tests carried out (*)

inspections	markings found on sample under inspection			
tests	STATIC test		point 5,2,1	TEST PASSED
	anchoring structure	reinforced concrete		
	applied force	kN	10	std value 10,0 OK
	(FORCE APPLIED IN THE DIRECTION IN WHICH SAID FORCE CAN BE APPLIED DURING OPERATION)			
	application time	min	3	minimum 3 OK
	THE DEVICE	HOLDS		THE LOAD OK
	DYNAMIC test		point 5,2,2	TEST PASSED
	anchoring structure	reinforced concrete		
	falling mass	kg	100	std value 100,0 OK
	height of fall	mm	2500	min std value 2450,0 max std value 2550,0 OK
(HORIZONTAL DISTANCE FROM THE ANCHORING POINT TO THE LOAD APPLICATION POINT MAX. 300 MM)				
THE MASS	HAS	BEEN ARRESTED BY THE DEVICE OK		


ANALYSIS OUTCOMES	STATIC LOAD TEST	PASSED	DYNAMIC LOAD TEST	PASSED
--------------------------	------------------	---------------	-------------------	---------------

THE OVERALL OUTCOME OF THE TESTS CONFIRMS THE DECLARED CLASS

NOTES NV = not evaluated NC = not compliant

the experimenter
 Cardinetti ing. Angelo

the head of laboratory
 dott.ing. Loris Turella



Veneta Engineering s.r.l.
 37135 VERONA Via Lovanio 8/10
 Telefono 0458200948 telefax 0458201982
 www.venetaengineering.it

Organismo notificato di certificazione europea n. 0505
 Macchine - Ascensori - Recipienti semplici a pressione - Rumore
 Organismo d'ispezione di tipo "A" Impianti elettrici

9101
VERIFICA
ATTREZZATURE
DALAVORO

Laboratorio di Prove

Authorized by Ministero dello Sviluppo Economico on 15 Jan. 2008 pursuant to articles 10 & 11 part A of EEC Directive 89/686/EEC "PPE-Personal Protective Equipment" dated 01 Jan. 08 (G.U. no. 24 of 29 Jan. 08)

To:
HB SECURITY S.R.L.

VIA DELL ADIGE, 5
CORTACCIA


39040

BZ

TEST REPORT No. 297/EN VAR	date: 03/04/2012	ORIGINAL
Acceptance record no. 79788	date: 27/02/12	
TESTS ON ANCHOR DEVICES - PROTECTION AGAINST FALL FROM A HEIGHT		EN 795 P9101 33-32-0-1-0

dates: test start 23/03/2012 test end 23/03/2012 sample
samples delivered SAME-AS PRODUCTS

REF. (as declared by client)	MARKET NAME H-50 REVOLVING POSTS
	CHARACTERISTICS RIGID ARTEFACT FOR TWO USERS
	SAMPLING SITE

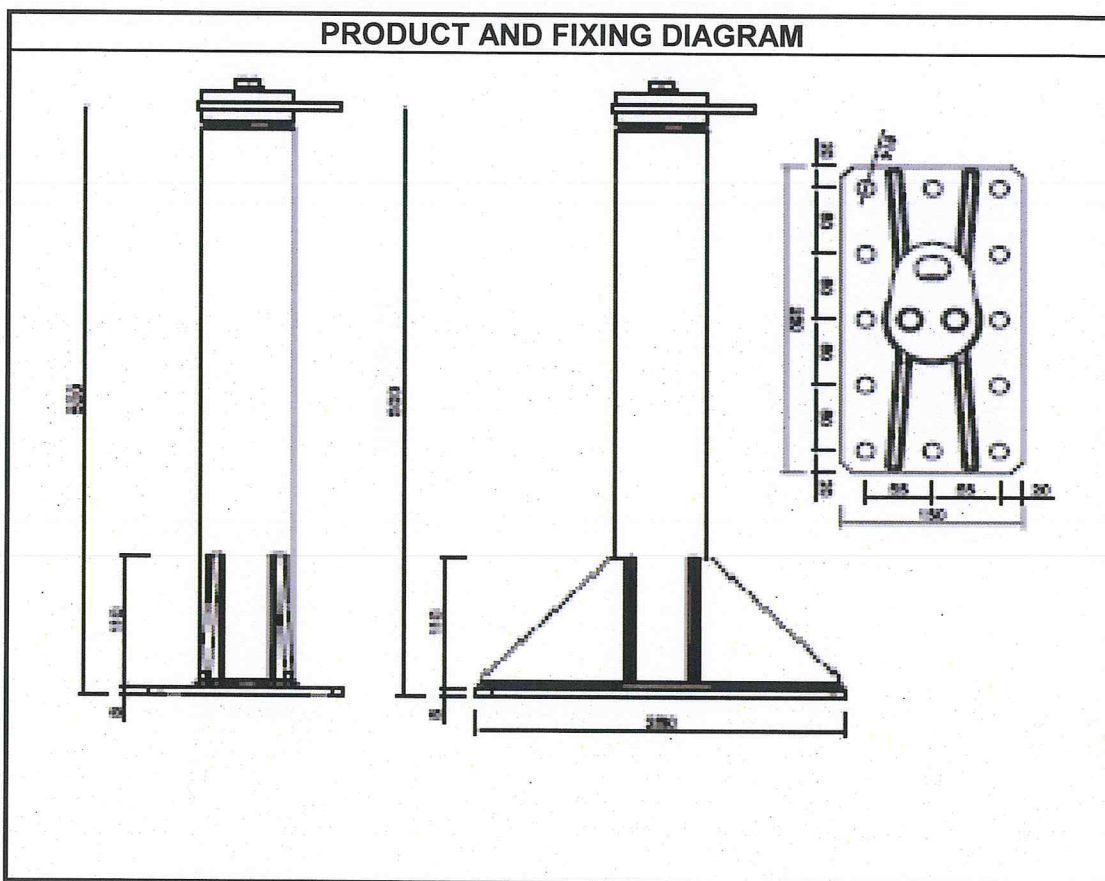

the experimenter
 Cardinetti ing. Angelo

(Handwritten signature of Angelo Cardinetti)

the head of laboratory
 dott.ing. Loris Turella

(Handwritten signature of Loris Turella)